


1/2 in. HOLES FOR
3/8 in. FASTENERS

1/4 x 2 in FLAT STOCK
(2 SIDES)

90 deg. BEND

ALUMINUM ROUND BAR

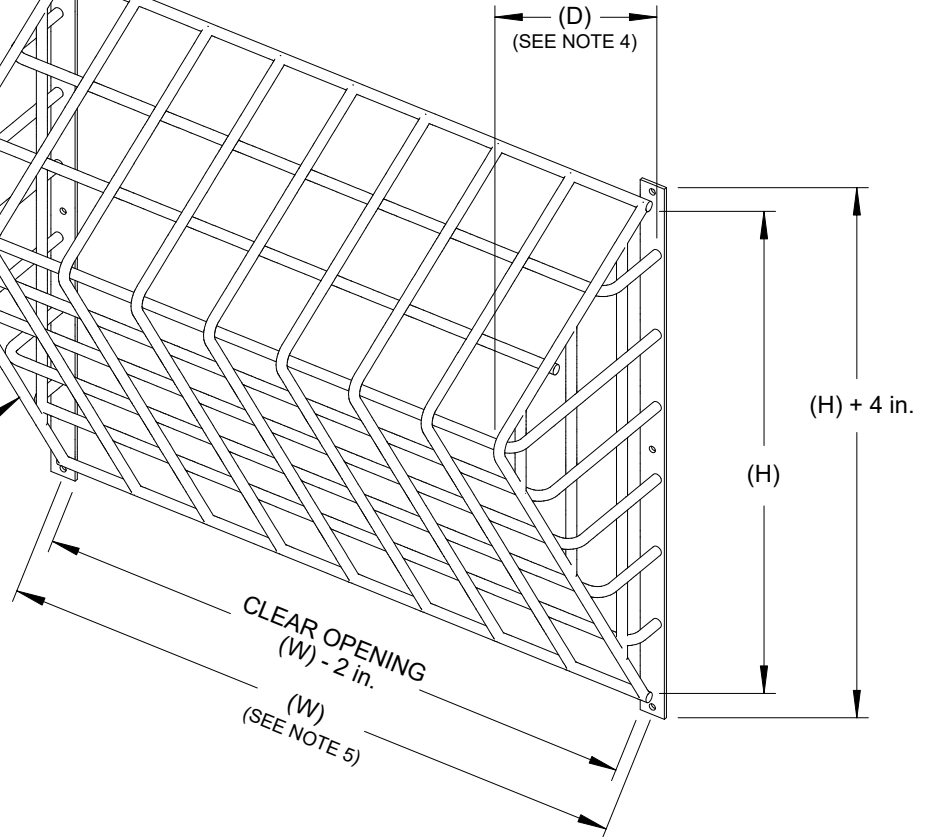

NOTES:

1. ALL MATERIALS TO BE ALUMINUM 6061-T6 ALLOY.
2. WELD ALL INTERSECTIONS.
3. FASTEN TO CONCRETE STRUCTURE WITH 3/8 in. x 3 in. STAINLESS STEEL CONCRETE WEDGE ANCHORS AT 18 in. MAX. SPACING. MINIMUM OF (4).
4. DEPTH (D) = 1/2 OF HEIGHT (H).
5. WIDTH TO CENTER LINE OF BARS (W) = STRUCTURE OPENING WIDTH ROUNDED UP TO NEAREST INCREMENT OF REQUIRED BAR CENTERLINE SPACING. EX: 36 in OPENING IN STRUCTURE WITH 4 in. BAR CENTERLINE REQUIRED = 40 in.
6. OPTIONAL - 10g STAINLESS STEEL WIRE MESH WITH 1 in. GRID TO COVER RACK.

TRASH RACK INFORMATION

BAR DIAMETER (1/2" OR 3/4")	
BAR CENTERLINE SPACING	
RACK WIDTH TO BAR CL (W)	
RACK HEIGHT I.D. (H)	
DEPTH (D) = 1/2 OF (H)	
STRUCTURE OPENING W	
STRUCTURE OPENING H	
FASTENERS (QTY)	
WEIR EXTENDS TO TOP?	
WIRE MESH?	
NOTES:	

This CAD file and drawing is the property of Effluent Design & Fabrication, LLC. It is intended for the named recipient. Unauthorized reproduction, disclosure, or distribution is strictly prohibited.



6 William Martin Way
Flemington, NJ 08822

Phone: 908.458.9220
FAX: 908.458.9930

PROJECT:
ALUMINUM TRIANGULAR SERIES AT RACK

FILE #:

DATE:

SCALE:

DRAWN BY: